NOTES:
1. ALL OF THE EXISTING BUILDING FOUNDATION WALLS ARE APPROXIMATLY 16" REINFORCED CONCRETE.
2 ALL OF THE EXISTING BUILDING FLOORS ARE APPROXIMATLY 4" THICK REINFORCED CONCRETE.
3 CONTRACTOR SHALL RESEARCH PLANS OF THE EXISTING UNDERGROUND UTILITIES WHICH ARE ON FILE IN THE ENGINEERING BUILDING #1 BEFORE ANY EXCAVATION IS STARTED.
4 AT CORRIDOR AND STEAM TUNNEL CROSSINGS THE CONTRACTOR SHALL INSTALL DUCT LINES BENEATH THESE AREAS. CONFIRM ALL LOCATIONS IN ENGINEERING OFFICE.

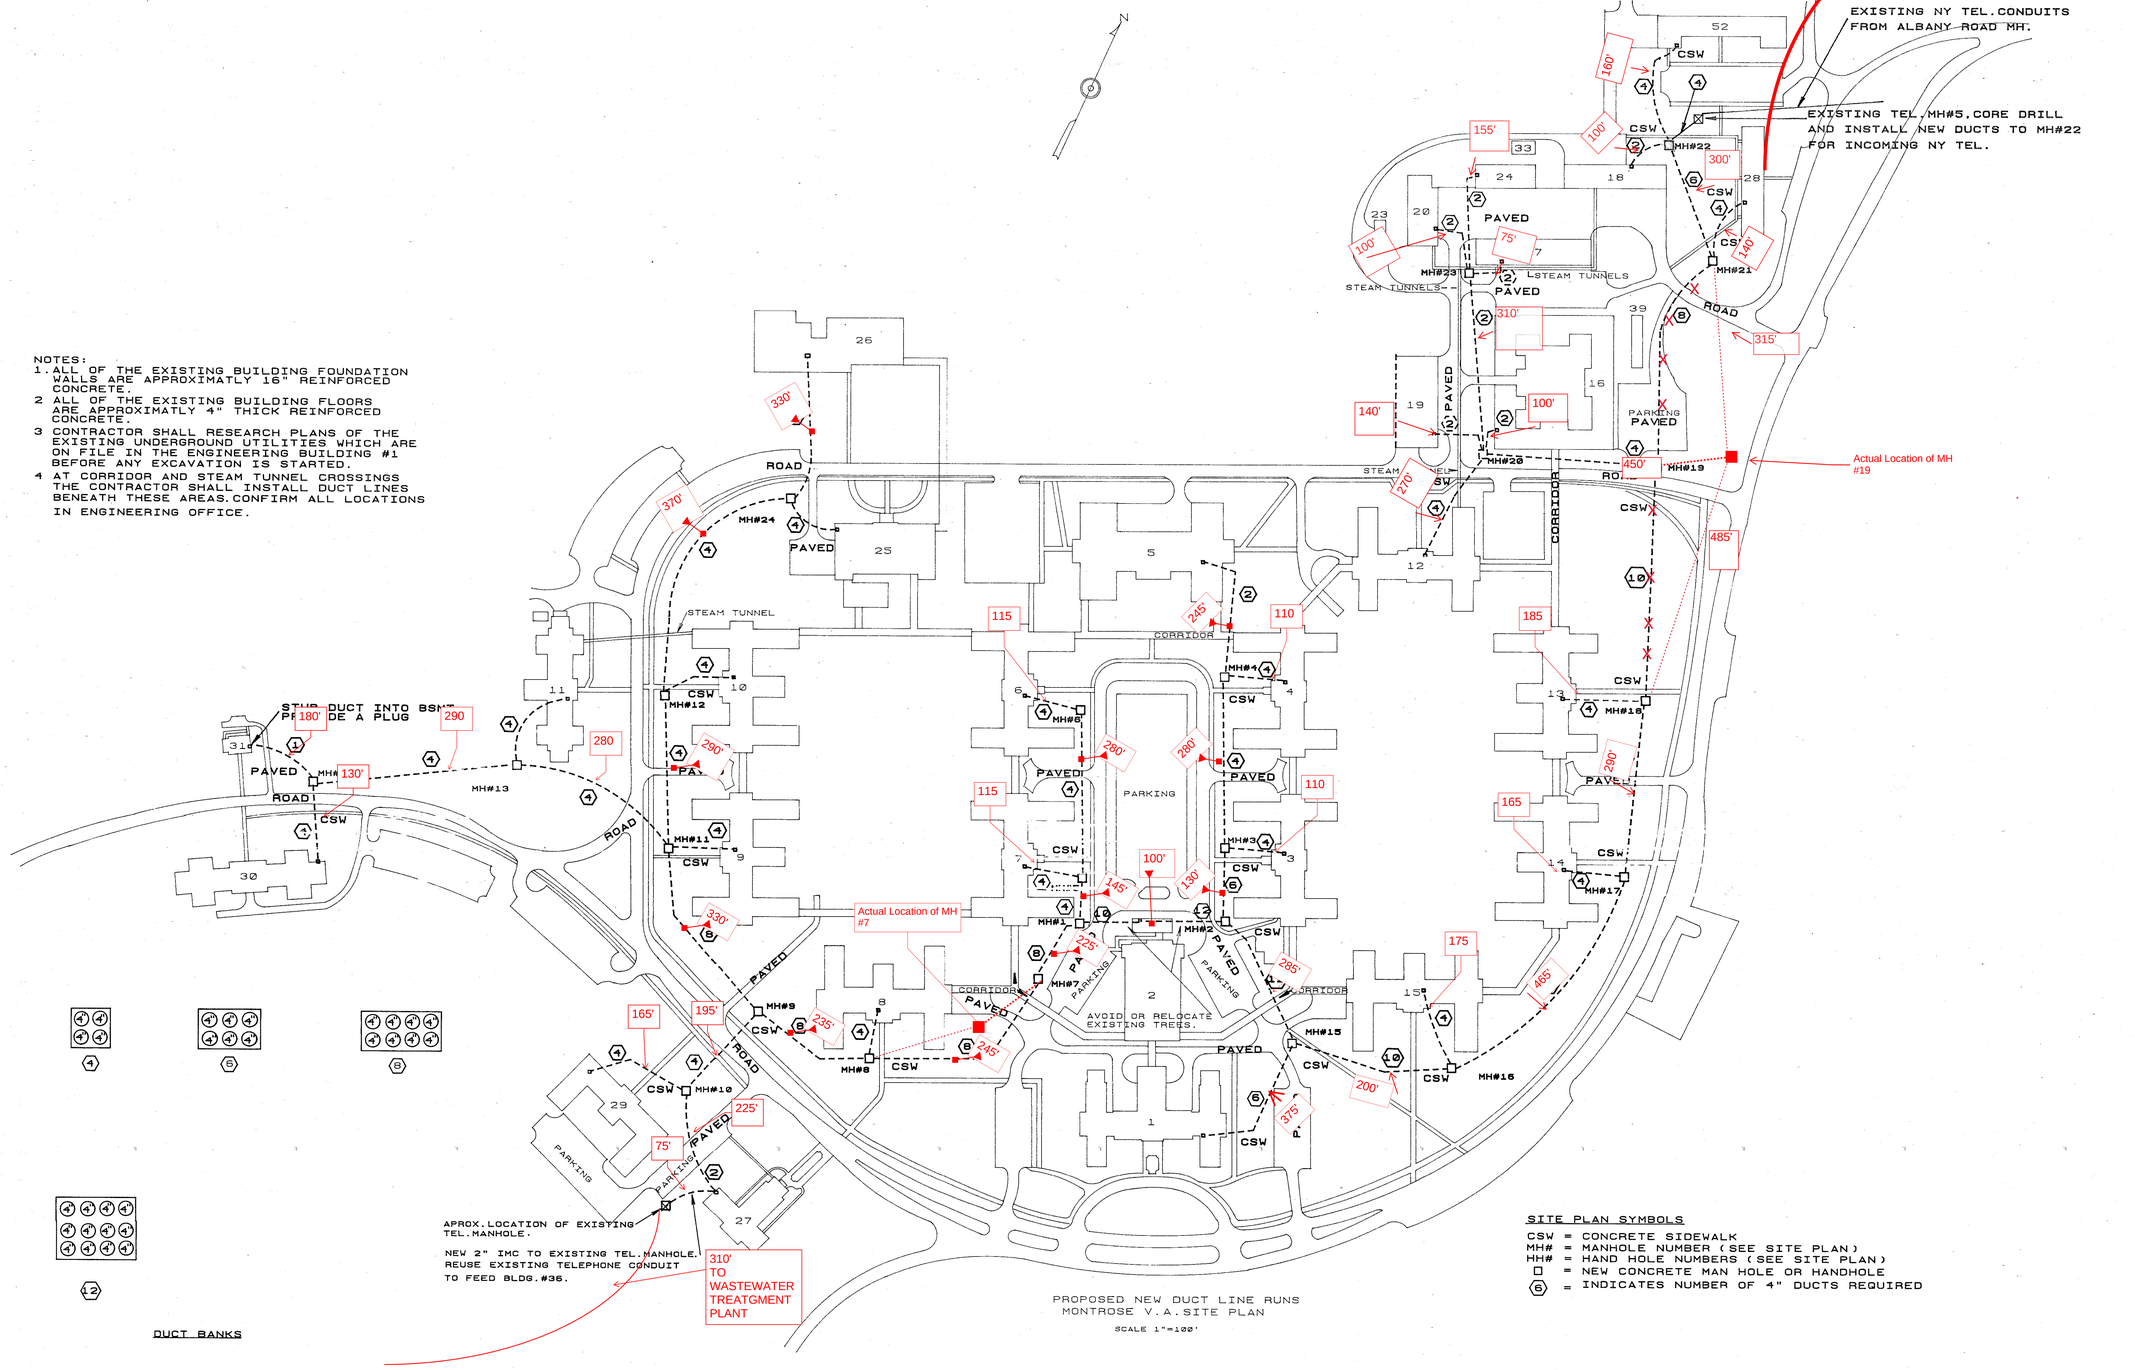

DUCT BANKS

SITE PLAN SYMBOLS

CSW = CONCRETE SIDEWALK
MH# = MANHOLE NUMBER (SEE SITE PLAN)
HH# = HAND HOLE NUMBERS (SEE SITE PLAN)
□ = NEW CONCRETE MAN HOLE OR HANDHOLE
(6) = INDICATES NUMBER OF 4" DUCTS REQUIRED

PROPOSED NEW DUCT LINE RUNS
MONTROSE V.A. SITE PLAN
SCALE 1"=100'

REVISIONS	DATE

E.M. SULLIVAN CO. INC.
CONSULTING ENGINEERS
2 WESTON STREET
WILBRAHAM MA 01095-1031

DRAWING TITLE	SITE PLAN NEW TELEPHONE DUCT LINES
PROJECT TITLE	RENOVATE TELEPHONE SYSTEM
DATE	JUN 21 1993
PROJECT NUMBER	620-92-145
APPROVED: CHIEF ENGINEER	
BUILDING NUMBER	ALL
CHECKED	
DRAWN	
DRAWING NO.	S-1
APPROVED: MEDICAL CENTER DIRECTOR	
LOCATION	MONTROSE NY 10548-0100
	Dwg 2 of 87

OFFICE OF FACILITIES
DEPARTMENT OF VETERANS AFFAIRS